


4: CONVENTIONAL FIRE DETECTION

12 Zone Control Panels

GENT

by Honeywell

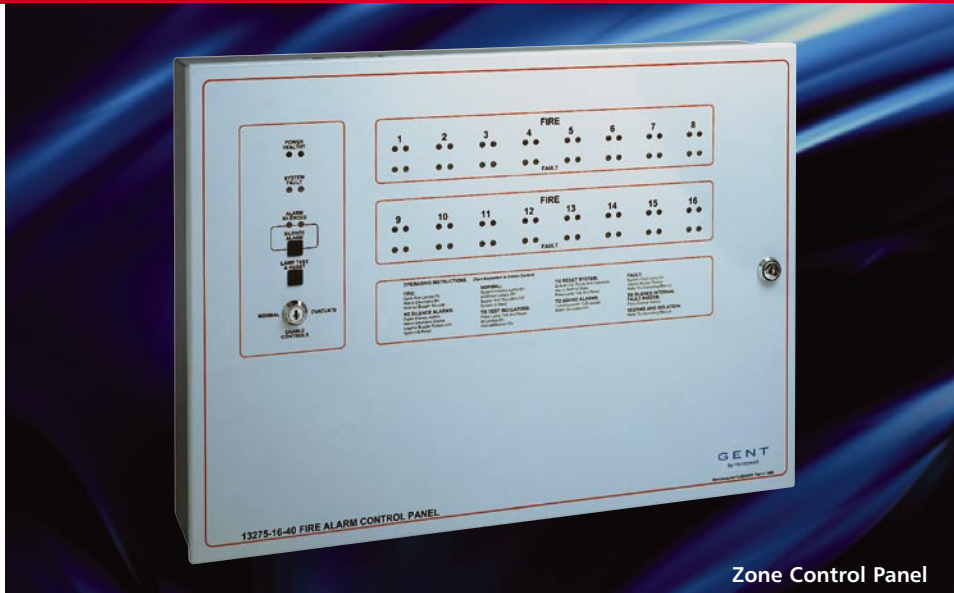


Zone Control Panel

For larger applications a 12 zone conventional panel is available. The panel complies with BS 5839 and includes facilities such as one man zone test, bomb alert and zoned or two stage alarm outputs as required. For larger panel sizes or flush mounting versions please contact Gent.

TECHNICAL SPECIFICATION	
No. of Zones	12
Maximum Load per Zone	1.6mA
No. of Sounder Circuits	2 (extra sounder circuits may be added using 4 way sounder cards)
Max. Sounder Circuit Load	1A per circuit
Batteries	2 x 7Ah, 12V
Battery Standby	24 hours - For 48 hour or 72 hour requirements consult Gent
Aux. Relay Contacts All contacts rated at 30 Vdc 1A maximum	Common fire contacts - Operates on fire condition
	Zonal fire contacts - Per zone, operates on fire condition
	Alarm contacts - Operates with alarm sounders
	Fault contacts - Operates on any fault condition
Approx Weight	15kg
Cable Entry	Top and bottom
Class Change Facility	Yes

Note: If additional sounder circuits are required an extra power supply unit may be needed.

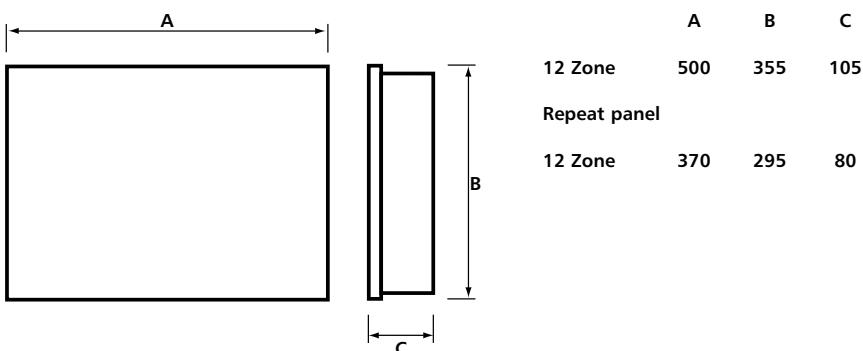

ORDER CODES

12 Zone	13275-12
Repeat Panel	
12 Zone	03276-12
4 Way Extension	
Sounder Card	03277-04